
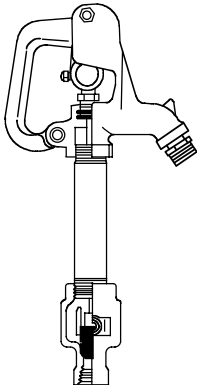
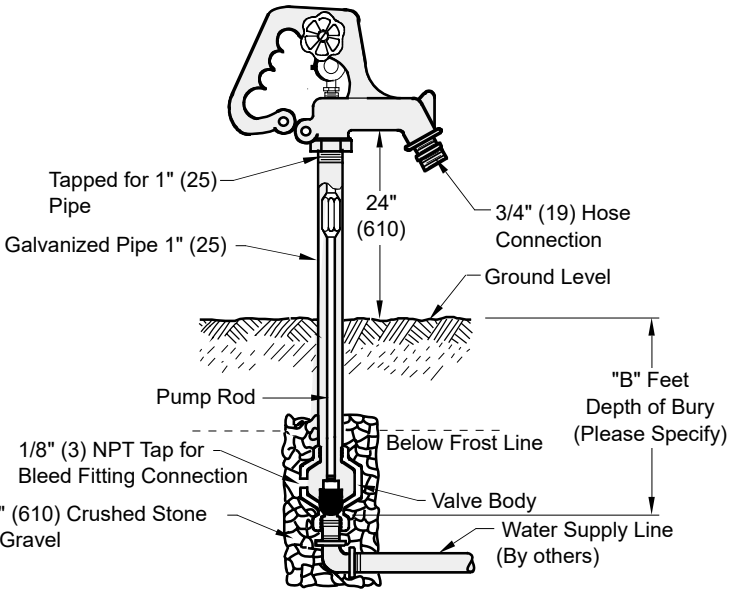


V	   				LOCATION			
	NON-FREEZE POST HYDRANT							
	 FIG. 5909							
	 Tapped for 1" (25) Pipe Galvanized Pipe 1" (25) 24" (610) 3/4" (19) Hose Connection Ground Level Pump Rod 1/8" (3) NPT Tap for Bleed Fitting Connection 24" (610) Crushed Stone or Gravel Below Frost Line Valve Body Water Supply Line (By others) "B" Feet Depth of Bury (Please Specify) B (Depth of Bury) = 02(610), 03(915), 04(1220), 05(1525) or 06(1830) Feet							
 Stem Screw Square Head Set Screw "O" Rings Handle Fulcrum Bolt and Lock Nut Flow Lock Wheel Connector Links (Pair) Head Casting (Painted Green) Packing Nut Hose Adapter 3/4" (19) Brass Extension Rod 7/16" (11) Rod Coupling 7/16" (11) Galvanized Pipe 1" (25) Valve Body 1/8" (3) NPT Drain Hole Pump Rod 7/16" (11) Plunger								
REGULARLY FURNISHED: Non-Freeze Post Hydrant with Galvanized Casing and Adjustable Flow Wheel Lock Handle. VARIATIONS: ☐ Vacuum Breaker -H (Note 1&4) ☐ 1"(25) Hose Connection -HC1 ☐ 1"(25) Female Inlet Connection -MF-1								
NOTE: - Hose must be removed to allow proper draining of the casing. Smith is not responsible for any casings that burst or related incidents if the hose is not removed. - Dimensions shown in parentheses are in millimeters. - The AB100, AB1953, California Lead Law, and NSF/ANSI Standard 61- Drinking Water System Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking. - Vacuum breaker not available with 1"(25) Hose Connection Adaptor -HC1. FOR IRRIGATION PURPOSES ONLY. - Temperature Range: 33.0°F to 140.0°F (0.6°C to 60.0°C).								
FIGURE NUMBER	V	2-4-25	Revised Notes	HS	BW	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
	UTS	10-18-24	Revised Notes	HS	CL			
		8-4-23	Removed Function	HS	CL			5909
		3-22-23	Removed Notes 5 & 6 ASL/TL	KK	JT			
REV.	DATE	DESCRIPTION			BY	CKD. BY		

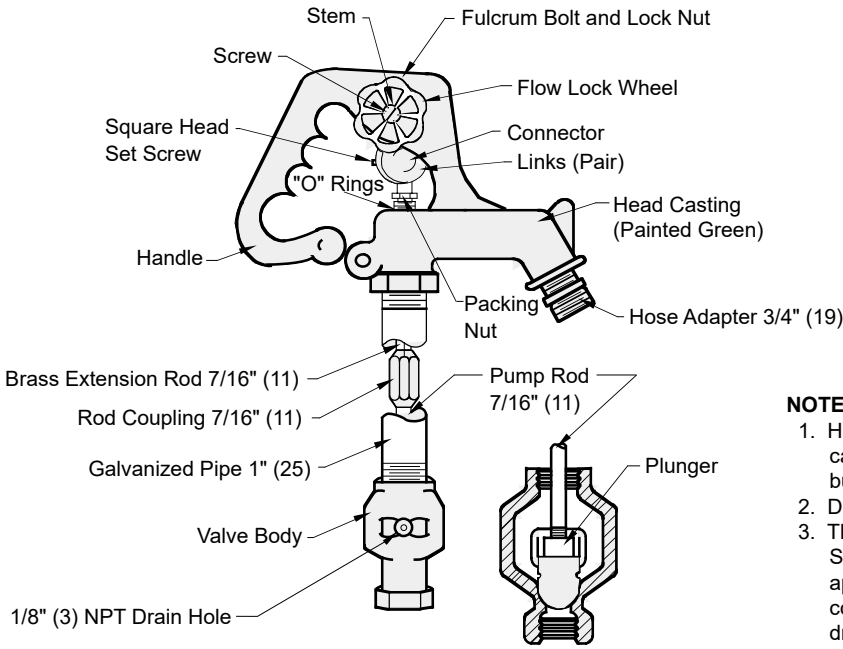

WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov